

AIR CONDITIONING SYSTEM JOBSITE INFORMATION SHEET

OWNER

Name

Address

City State Zip Code

Contact Phone

SERVICING CONTRACTOR

Name

Address

City State Zip Code

Contact Phone

DISTRIBUTOR

Name

Address

City State Zip Code

Contact Phone

Requestor Date Requested

EQUIPMENT DATA

OUTDOOR UNIT		EVAPORATOR	
Model #	<input type="text"/>	Model #	<input type="text"/>
Serial #	<input type="text"/>	Serial #	<input type="text"/>
Date Installed	<input type="text"/>	Date Installed	<input type="text"/>
AIR HANDLER		FURNACE	
Model #	<input type="text"/>	Model #	<input type="text"/>
Serial #	<input type="text"/>	Serial #	<input type="text"/>
Date Installed	<input type="text"/>	Date Installed	<input type="text"/>

Problem Summary

Corrective Actions Taken

Additional Information

ACCESSORIES? (Check those installed):

<input type="checkbox"/> Low Ambient kit	<input type="checkbox"/> Filter-Drier	<input type="checkbox"/> Discharge Line Muffler	<input type="checkbox"/> Other
<input type="checkbox"/> Compressor Time Delay	<input type="checkbox"/> Compressor Sound Enclosure	<input type="checkbox"/> Hot Water Recovery	<input type="text"/>
<input type="checkbox"/> Mild Weather Kit	<input type="checkbox"/> Oil Separator	<input type="checkbox"/> Hot Gas Bypass	
<input type="checkbox"/> Crankcase Heater	<input type="checkbox"/> High Pressure Cutout	<input type="checkbox"/> Pump Down Kit	
<input type="checkbox"/> Hard Start Kit	<input type="checkbox"/> Low Pressure Cutout	<input type="checkbox"/> Accumulator	

AIR CONDITIONING JOBSITE INFORMATION SHEET

REMEMBER:


1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Circle Service Ports used.
4. Sat. Temp. is pressure converted to Temp.

Formula For Super Heat

	Vapor Line Temp.
	Minus Sat Temp.
<div style="border: 1px solid black; width: 100%; height: 30px;"></div> Equals Super Heat	

Formula For Sub Cooling


	Sat Temp.
	Minus Liquid Line Temp.
<div style="border: 1px solid black; width: 100%; height: 30px;"></div> Equals Sub Cooling	

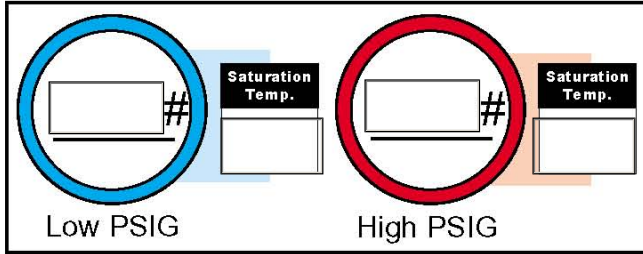

Inside Temp. Leaving

DB:

WB:

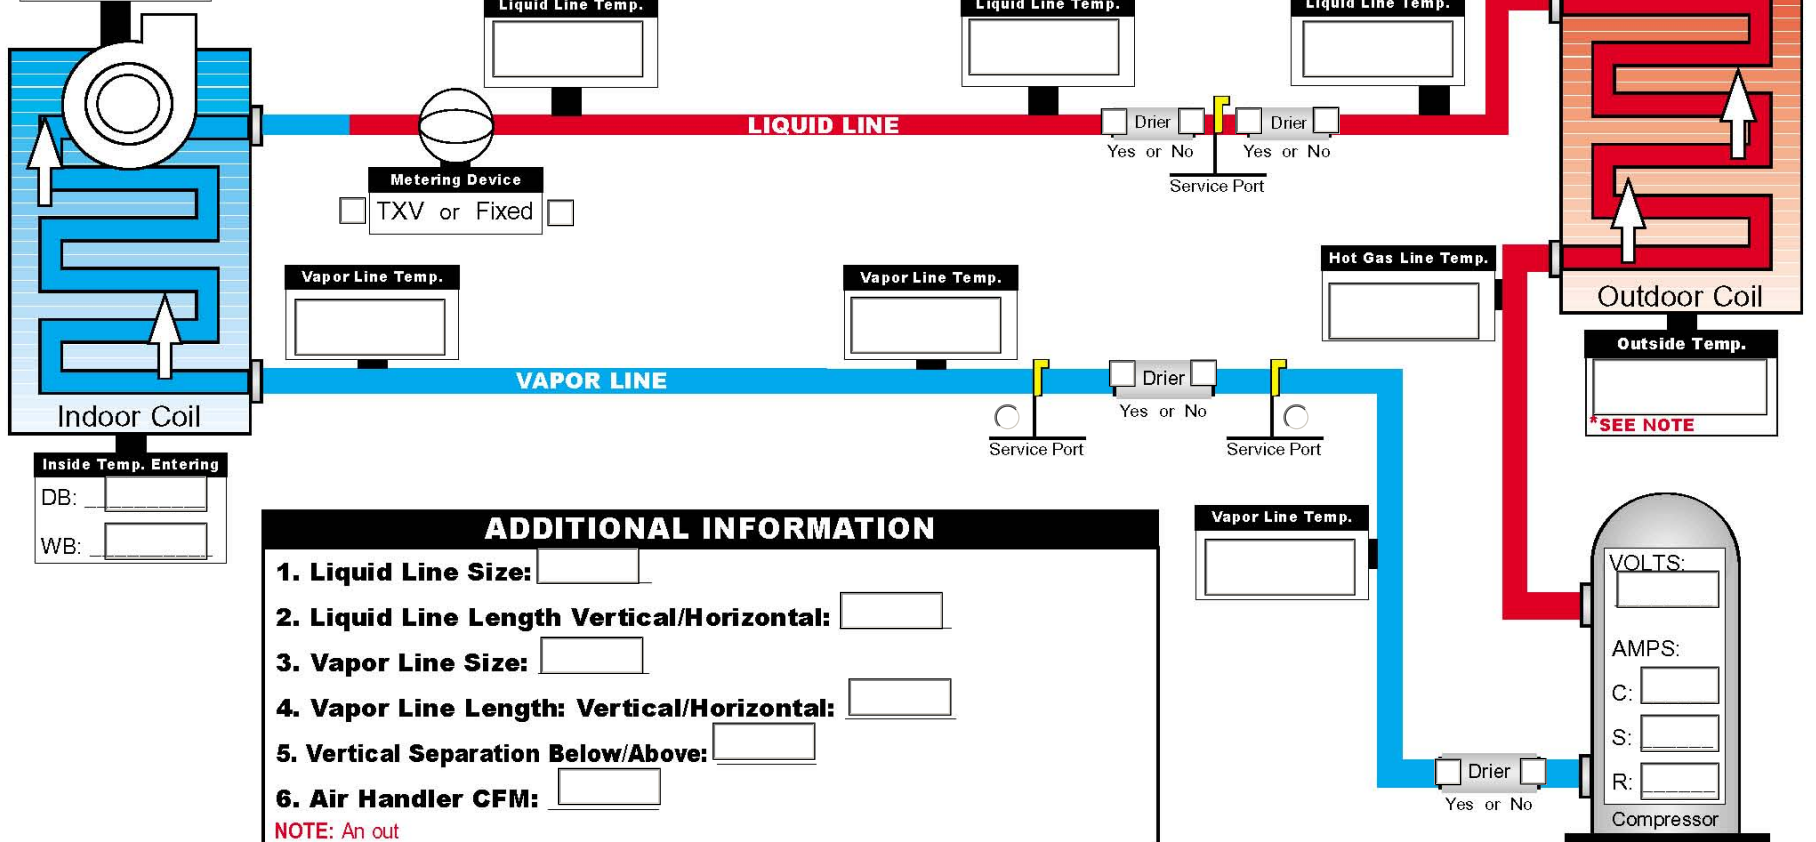

ADDITIONAL INFORMATION

1. Liquid Line Size:
2. Liquid Line Length Vertical/Horizontal:
3. Vapor Line Size:
4. Vapor Line Length Vertical/Horizontal:
5. Vertical Separation Below/Above:
6. Air Handler CFM:

NOTE: An out

VOLTS:

AMPS:

C:

S:

R: