



# SUBMITTAL INFORMATION

## Restrainer (UFR1300-S-x-I style)

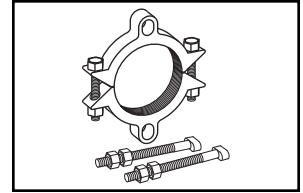

**SERIES 1300-S 2" - 12" RESTRAINT DEVICE FOR PVC PIPE OR HDPE PIPE  
AND MECHANICAL JOINT / PUSH-ON FITTINGS**

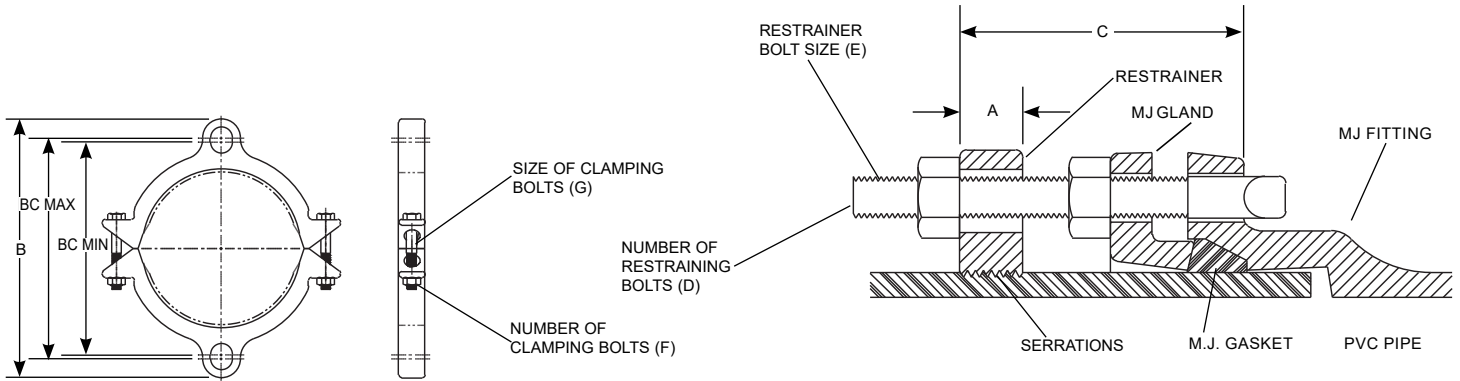

NOM PIPE SIZE	PVC PIPE WITH STEEL PIPE OD STYLE 1300-S		A	B APPROX	C MAX	RESTRAINING BOLTS		CLAMPING BOLTS		BC MAX	BC MIN	APPROX. WT. LBS.	✓ SUBMITTED ITEMS
	OD	CATALOG No.				No. D	SIZE E	No. F	SIZE G				
2"	2.375	UFR1300-S-2-I	1-1/8"	6-3/8"	4"	2	5/8" x 5"	2	5/8" x 3-1/2"	4.76"	4.40"	6.3	
2-1/2"	2.88	UFR1300-S-25-I	1-1/8"	6-7/8"	4"	2	5/8" x 5"	2	5/8" x 3-1/2"	5.38"	5.14"	6.5	
3"	3.50	UFR1300-S-3-I	1-1/8"	7-11/16"	4"	2	5/8" x 5"	2	5/8" x 3-1/2"	6.18"	5.82"	7.4	
4"	4.50	UFR1300-S-4-I	1-1/8"	9-1/8"	6"	2	3/4" x 7"	2	5/8" x 3-1/2"	7.50"	7.14"	8.5	
6"	6.625	UFR1300-S-6-I	1-1/8"	11-1/8"	6"	2	3/4" x 7"	2	5/8" x 3-1/2"	9.50"	9.14"	10.0	
8"	8.625	UFR1300-S-8-I	1-1/4"	13-7/8"	6"	2	3/4" x 7"	2	3/4" x 4"	12.80"	11.76"	15.5	
10"	10.75	UFR1300-S-10-I	1-3/8"	16-5/8"	6"	4	3/4" x 7"	2	7/8" x 5"	15.00"	13.50"	26.5	
12"	12.75	UFR1300-S-12-I	1-3/8"	19-1/4"	6"	4	3/4" x 7"	2	7/8" x 5"	17.62"	15.62"	28.5	

### FEATURES

- 2" - 12" sizes: cast ductile iron per ASTM A536 grade 65-45-12
- Black e-coat epoxy coating with gray painted top coat for identification
- 360° contact and support of the pipe wall
- Ideal companion for push-on fittings with restraining ears
- T-Bolts (included) - High strength, low alloy steel ANSI / AWWA C111 / A21.11
- Side Clamping Bolts and Nuts - Grade 5, zinc-plated
- Rated at full-rated pressure of any class of PVC pipe or HDPE; minimum 2:1 safety factor

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



**The Ford Meter Box Company, Inc.**

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443

Phone: 260-563-3171 / Fax: 800-826-3487

Overseas Fax: 260-563-0167

www.fordmeterbox.com



07/28/17

Submitted By: